

ASSEMBLY, INSTALLATION & OPERATING INSTRUCTIONS SERIES VB, VBM, VBS VACUUM BREAKERS

1. IMPORTANT - BEFORE INSTALLING

Vacuum Breakers will open to allow air into a pipeline or vessel preventing siphoning, cavitation, or vacuum, when properly installed and used within the recommended ranges of pressure, temperature, and chemical compatibility. The ultimate determination of material compatibility is previous successful use in the same application. MINIMUM SERVICE TEMPERATURE IS 40°F. Call our Technical Support for information about your application.

Caution: Plastic materials will degrade in ultraviolet (UV) light or sunlight.

Caution: Polypropylene and PVDF (Kynar) often look similar. Do not install in your system if you are not sure.

2. INSTALLATION

For best results, Plast-O-Matic recommends placing vacuum breakers upright (see illustration) at the highest point in the piping system. The vacuum breaker will operate mounted in any direction. For anti-siphon applications, Plast-O-Matic recommends locating the vacuum breaker on a U-bend 5 feet above the liquid level to assure opening, because the vacuum breaker will begin to open when the pressure in the pipe drops below minus 1.0 to 1. PSIG.

Caution: A diaphragm failure under pressure, combined with a hazardous liquid, could cause dangerous spraying through the vacuum breaker, or hazardous fumes. Plast-O-Matic suggests Series CK, CKM or CKS check valves instead of VBM or VBS, with the inlet piped to an open drain or containment, for these applications.

Threaded Connections – A suitable thread sealant (ex. Teflon® tape) should be applied to male tapered threads to assure a “leak-tight” seal. The assembly need only be made “hand-tight” followed by a quarter (1/4) turn with a strap wrench. Do not over tighten or use pipe wrenches on plastic pipe and components.



Caution: Teflon® tape will “string” as pipe threads are joined. Loose “strings” could lay across the seating surface and prevent the valve from completely closing. To avoid this problem, clean out old tape, and do not apply tape to the first thread.

Caution: Connections should be made only to plastic fittings; metal pipe should only be installed with an intervening plastic nipple. Metal pipe and straight threaded pipe tend to cut, stretch, and distort the plastic bodies, which could result in cracking or leaking over time.

Non-Threaded Connections – For solvent cementing or heat fusion, follow instructions supplied with the cement or fusion equipment, or contact your distributor.

Caution: When using solvent cement for socket connections on PVC and CPVC check valves care should be taken. If primer or cement gets past welding area of the socket it can cause the valve to malfunction. The primer or cement may cause the seals to fail or moving parts to bind and restrict proper movement of internal parts.


Never trim the flat-end of the Teflon encapsulation on the spring. This may cause spring to be wetted by the process fluid.

3. MAINTENANCE

Plast-O-Matic recommends keeping a spare diaphragm or o-ring set available for repairs. Seal life will vary with applications due to cycles, temperature, pressures, chemicals and concentrations. Based on the application, a periodic inspection and maintenance plan should be established.

Note: Disassembly will void warranty.

4. PARTS AND ILLUSTRATION

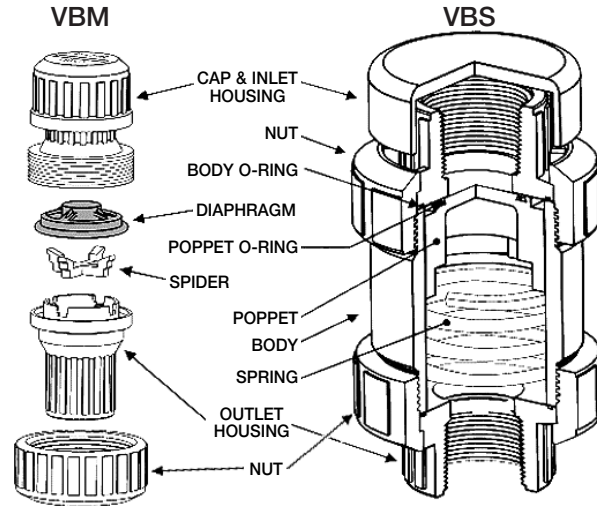


Series VB, not shown, has no SPIDER or NUT, and six (6) screws and nuts are used for assembly.

PART NUMBERS

VBM and VB Diaphragm - one required per valve			
VBM050 1/2"	VBM 3/4" & 1"	VB 3/4" & 1"	Diaphragm Material
1021EP	4054 EP	0721 EP	EPDM
1021V	4054 V	0721 V	Viton
VBS O-RINGS- 2nd Number requires two per valve			
VBS050 1/2"	VBS200 2"	VBS300 3"	O-Ring Material
0224EP	0224 EP	0230EP	EPDM
0040EP	0040EP	0155EP	
0224V	0224 EP	0230EP	Viton
0040V	0040V	0155V	

5. PERFORMANCE CHART

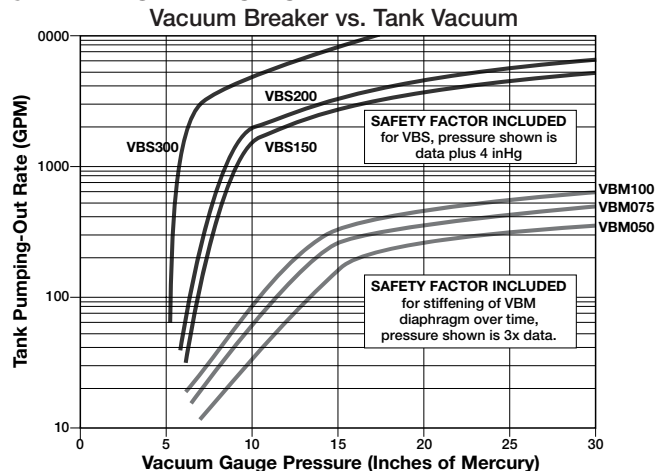

PLAST-O-MATIC VALVES, INC.

1384 Pompton Avenue, Cedar Grove, NJ 07009 USA

(973) 256-3000 • Fax: (973) 256-4745 • www.plastomatic.com • info@plastomatic.com